


# ATXP20-35N9

# FTXP20-35N9

THE " → " MARK SHOWS THE PIPING DIRECTION.

## REQUIRED SPACE FOR SERVICE AND VENTILATION

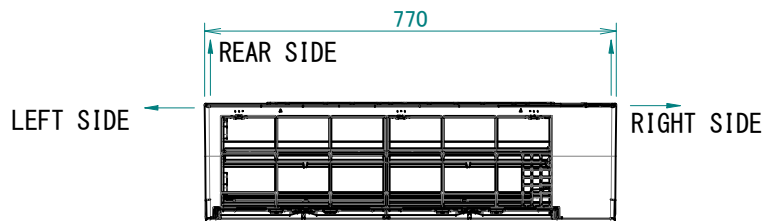

FRONT GRILLE FIXING SCREWS  
LOCATED INSIDE OF THE UNIT


FLAP




NAMEPLATE  
LOCATED INSIDE OF THE UNIT

SIGNAL RECEIVER  
OPERATION LAMP  
TIMER LAMP  
INDOOR UNIT ON/OFF SWITCH  
ROOM TEMPERATURE SENSOR  
LOCATED INSIDE OF THE UNIT


INCLUDING MOUNTING PALTE

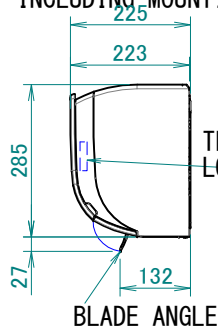

TERMINAL BLOCK WITH EARTH TERMINAL  
LOCATED INSIDE OF THE UNIT


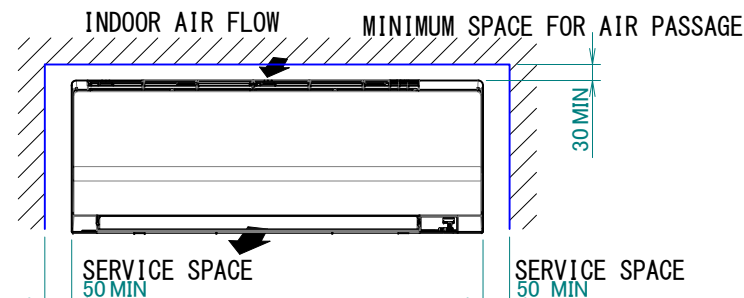


DRAIN HOSE  
INSIDE DIAMETER : 14mm  
OUTSIDE DIAMETER: 16mm  
CONNECTING PART  
THE LENGTH OF THE CONNECTION HOSE OUT  
SIDE THE UNIT IS 470mm.

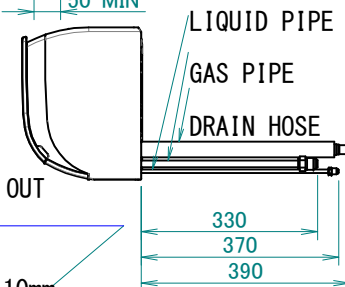


LIQUID PIPE  
Ø6.4mm CUT  
THE LENGTH OF THE PIPE OUTSIDE THE UNIT IS 410mm.

GAS PIPE  
Ø9.5mm CUT  
THE LENGTH OF THE PIPE OUTSIDE THE UNIT IS 360mm.

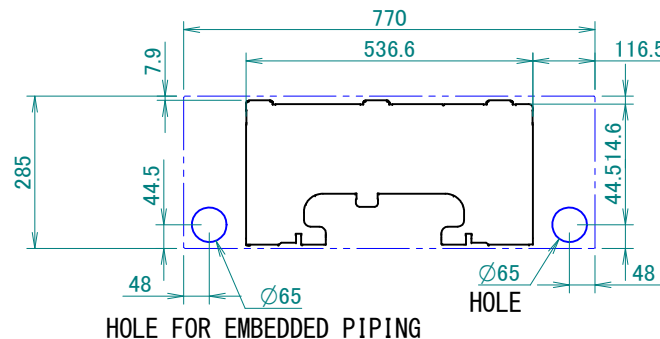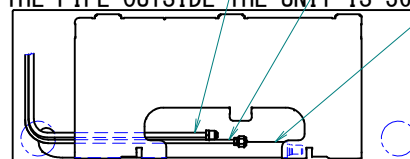


SIGNAL TRANSMITTER



## BLADE ANGLE

UP/DOWN (AUTOMATIC)

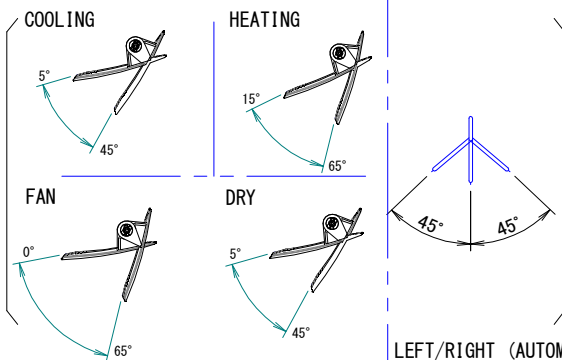

WIRELESS REMOTE CONTROL  
(ARC480A78)

STANDARD LOCATION OF HOLES IN THE WALL

3D144255